



Dobór zgodnie z normą
PN-HD 60364-4-443
i -5-534

Dobór ograniczników przepięć po stronie AC instalacji elektrycznej

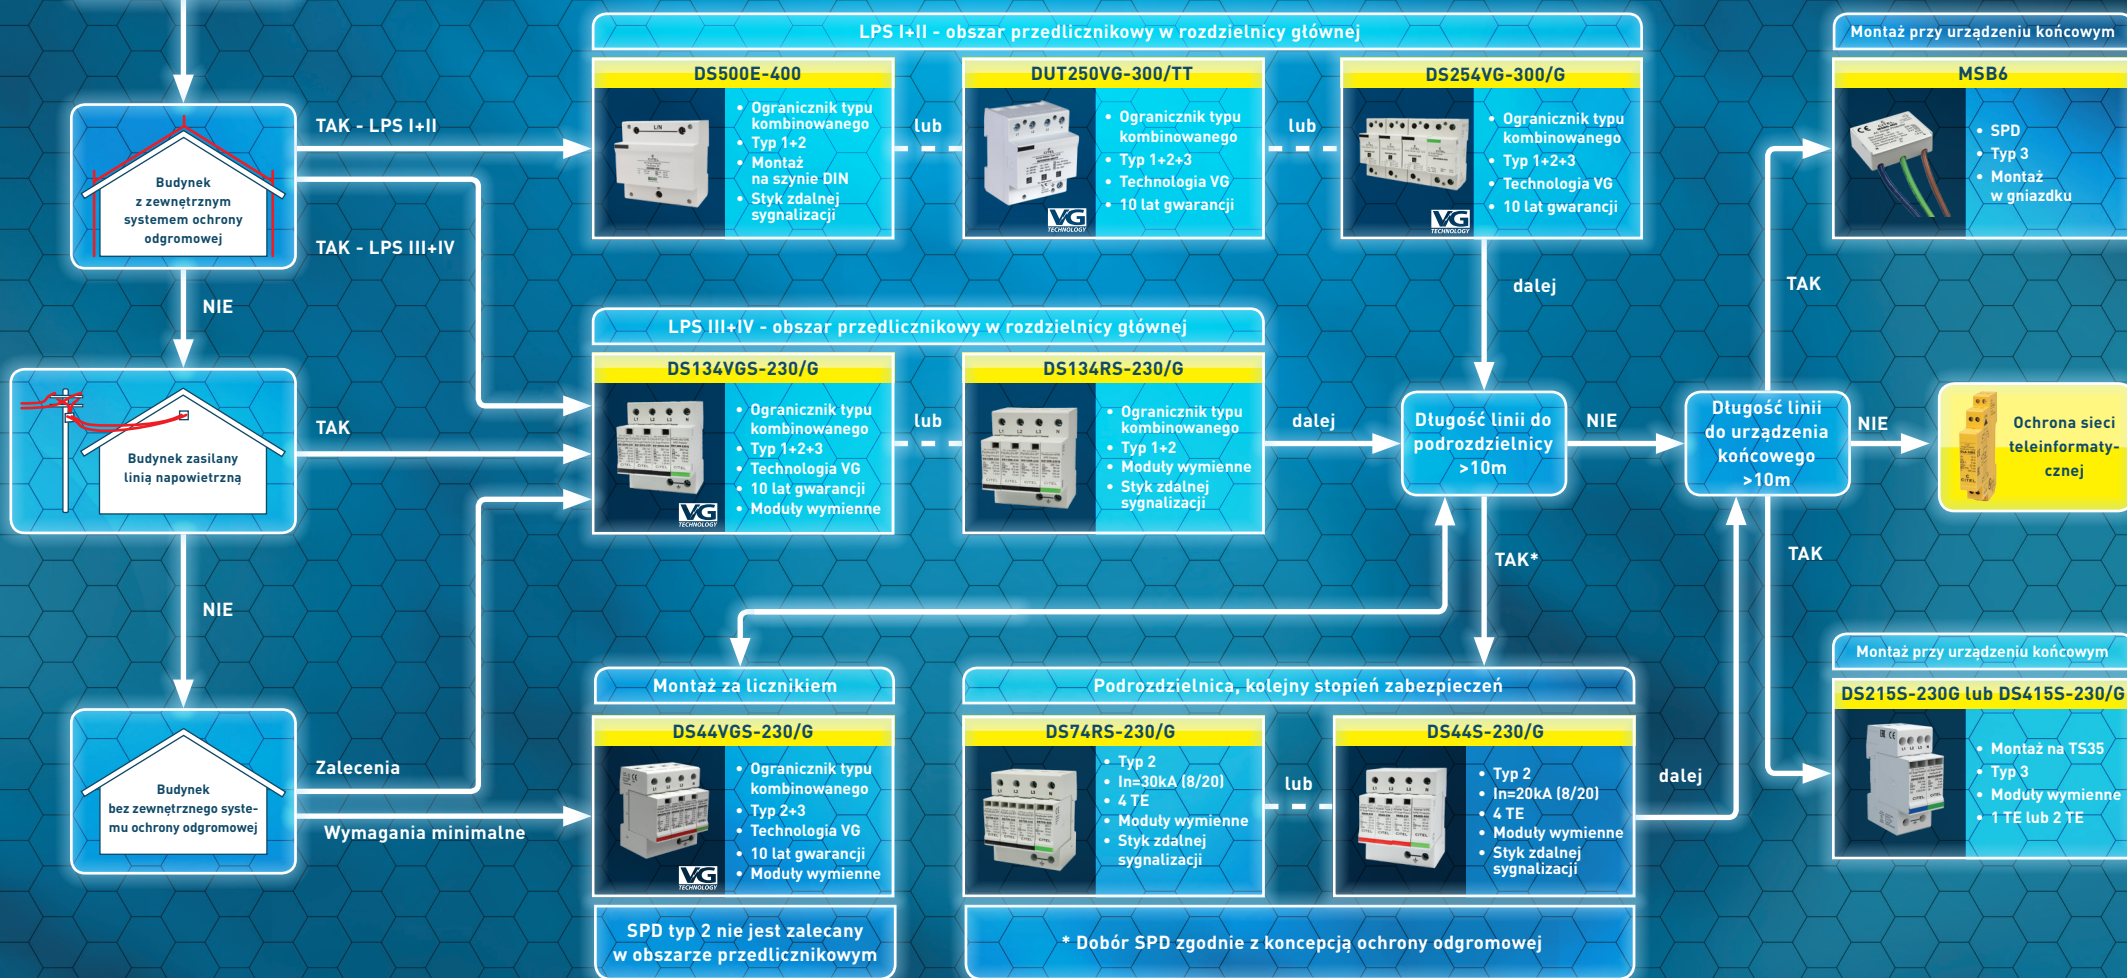

Montaż na adapterze															
Typ SPD	DS500E-400	DUT250VG-300/TNC	DUT250VG-300/TNS	DUT250VG-300/TT	DS253VG-300	DS254VG-300/G	DS133VGS-230	DS134VGS-230/G	DS133VGS-230/ZP	DS134VGS-230/G/ZP	DS44VGS-230/G	DS74RS-230/G	DS44S-230/G	DS215S-230/G	DS415S-230/G
Nr artykułu	C3964	C3588	C3597	C3582	C3896	C2756	C571583	C571584	C571583ZP	C571574ZP	C461582	C491532	C4615322	C451731	C451732
															C561302

Dobór ograniczników przepięć po stronie DC instalacji elektrycznej

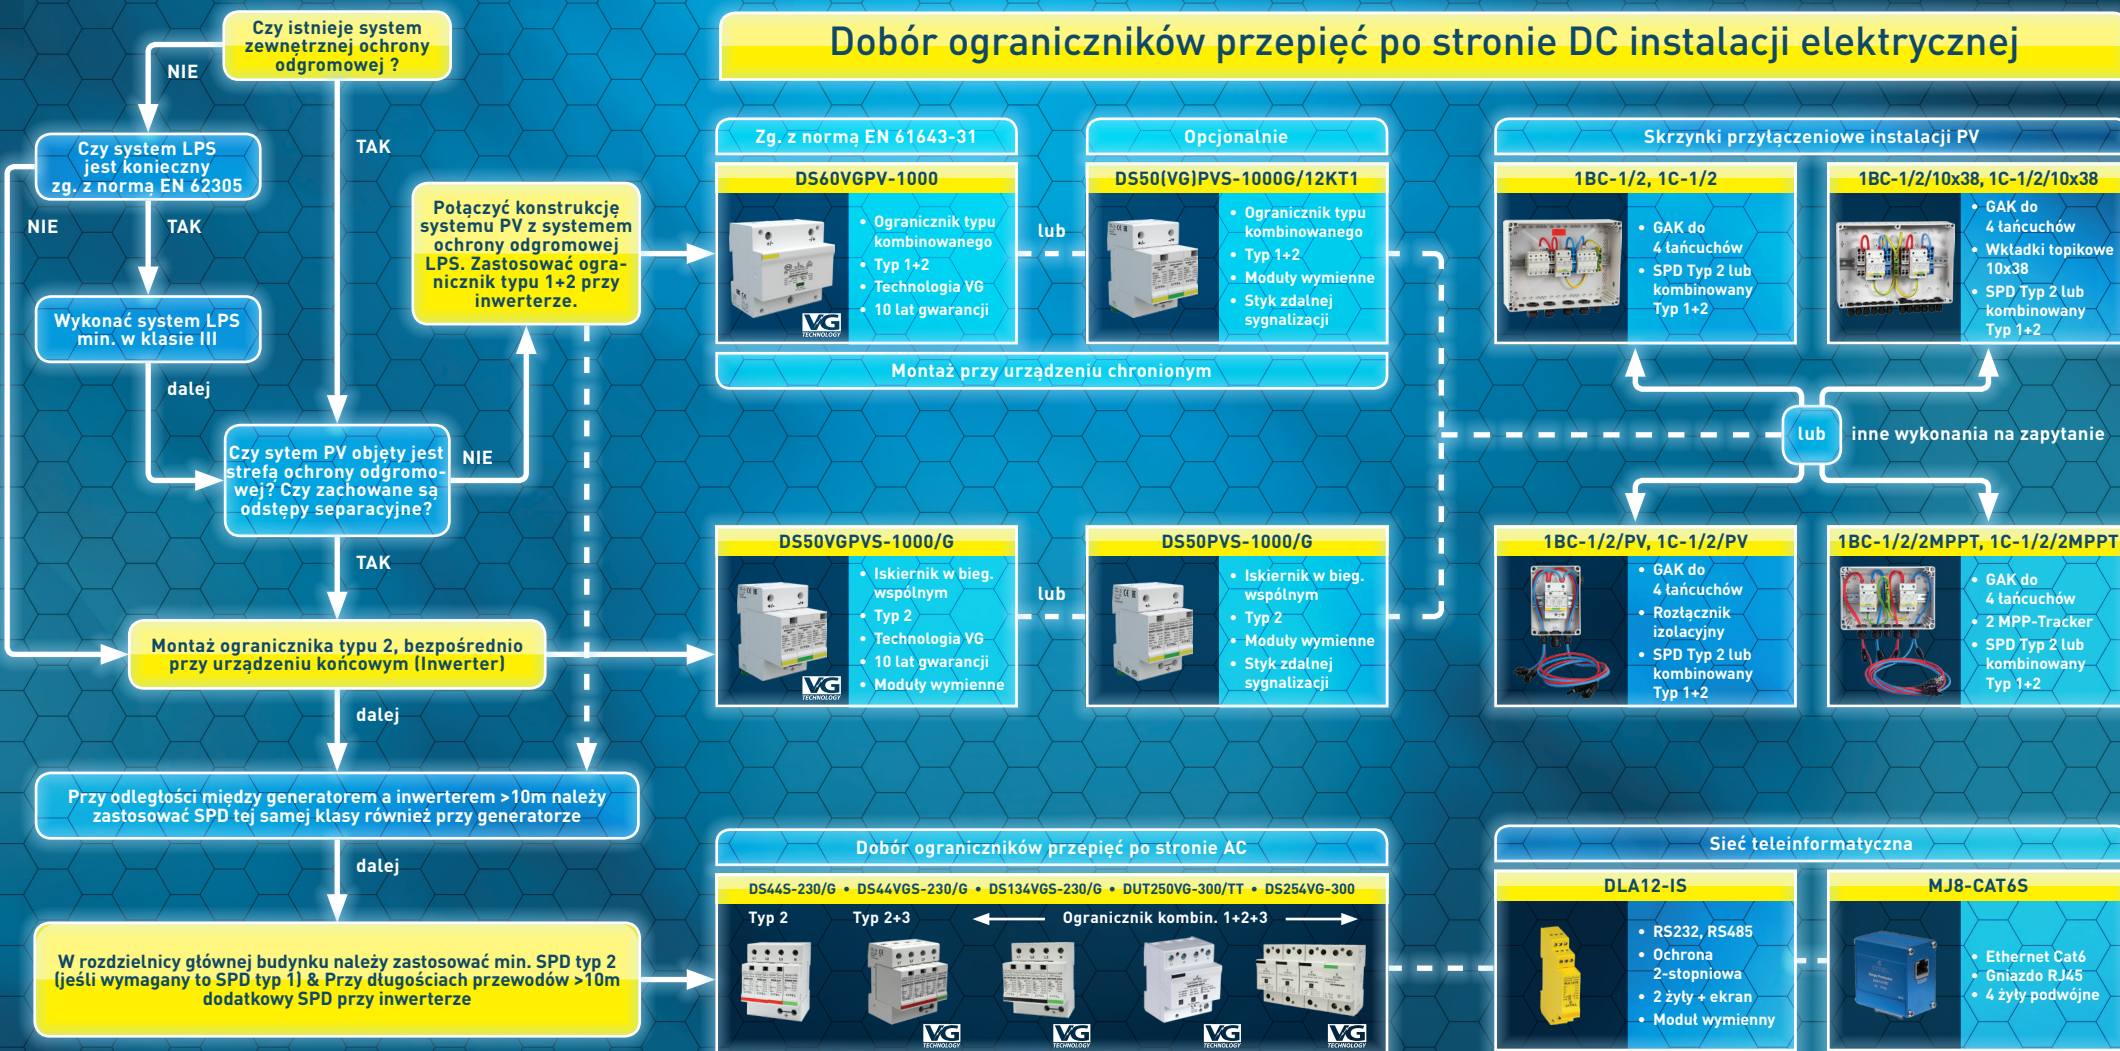

Napięcie generatora PV Uocac / Ucpv	500 Vdc	600 Vdc / 720 Vdc			1000 Vdc / 1200 Vdc					1250 Vdc / 1500 Vdc		
Typ SPD	DS50PVS-500/G	DS50PVS-600	DS50VGPVS-600G/51	DS51PVS-700	DS50PVS-1000G/51	DS50VGPVS-1000G/51	DS50VGPVS-1000G/12KT1	DS50PVS-1000G/12KT1	DS60VGPV-1000	DS50VGPVS-1500G/51	DS50PVS-1500/12KT1	DS60VGPV-1500G/51
Nr artykułu	C480141	C480411	C481411	C350411	C480391	C481311	C482313	C482393	C3947	C481511	C482573	C3956